SAFETY ORGANIZATIONS

THIS FILTER HAS BEEN FORMALLY RECOGNIZED, CERTIFIED OR APPROVED BY THE LISTED AGENCY. THEREFORE, ALL TEST/REQUIREMENTS SPECIFIED IN THE LATEST REVISION OF THE FOLLOWING AGENCY STANDARDS HAVE BEEN MET:

UL RECOGNIZED: UL 1283 CSA CERTIFIED: CSA 22.2, # 8 VDE APPROVED: VDE 565-3

OPERATING SPECIFICATIONS

LINE CURRENT/VOLTAGE: 3 AMP, 120/250 VAC,

3 AMP/40°C, 250 VAC

LINE FREQUENCY: 50-60Hz

MAXIMUM LEAKAGE CURRENT,

EACH LINE TO GROUND: 0.22 mA@ 120V 60Hz

0.38 mA@ 250V 50Hz

OPERATING AMBIENT TEMP. RANGE: -10°C TO +40°C @ RATED CURRENT, Ir.

IN AN AMBIENT, To, HIGHER THAN 40°C, THE MAXIMUM OPERATING CURRENT, Io, IS AS FOLLOWS: T = T = $\sqrt{-85}$ = T=

 $I_0 = I_r -$

RELIABILITY SPECIFICATIONS:

STORAGE TEMPERATURE: -40°C TO +85°C HUMIDITY: 21 DAYS @ 40°C 95% RH. CURRENT OVERLOAD TEST: 6 TIMES IN FOR 8 SECONDS

TEST SPECIFICATIONS:

INDUCTANCE: 1.45 mH NOMINAL CAPACITANCE: (MEASURED @ 1KHz, 0.250VAC MAX., 25°C±1°C)

LINE TO GROUND: 0.0053 µF ±20% 0.0105 µF ±20% LINE TO LINE:

DISCHARGE RESISTOR: 1.5 Ms

L/G AND L/L I.R

NO DISCHARGE RESISTOR: 6000M₁ (MIN.) @ 100VDC,

20°C AND 50% RH

CATALOG # 3EEA2

ECN # | APPRVD. | DATE


RECOMMENDED RECEIVING INSPECTION HIPOT:

1500VAC OR 2250VDC FOR 1 MINUTE LINE TO GROUND:

LINE TO LINE: 1450VDC FOR 1 MINUTE

FILTER APPROVAL:

THE BEST WAY TO SELECT AND QUALIFY A FILTER IS FOR YOUR ENGINEERING TO TEST THE UNIT IN YOUR EQUIPMENT.

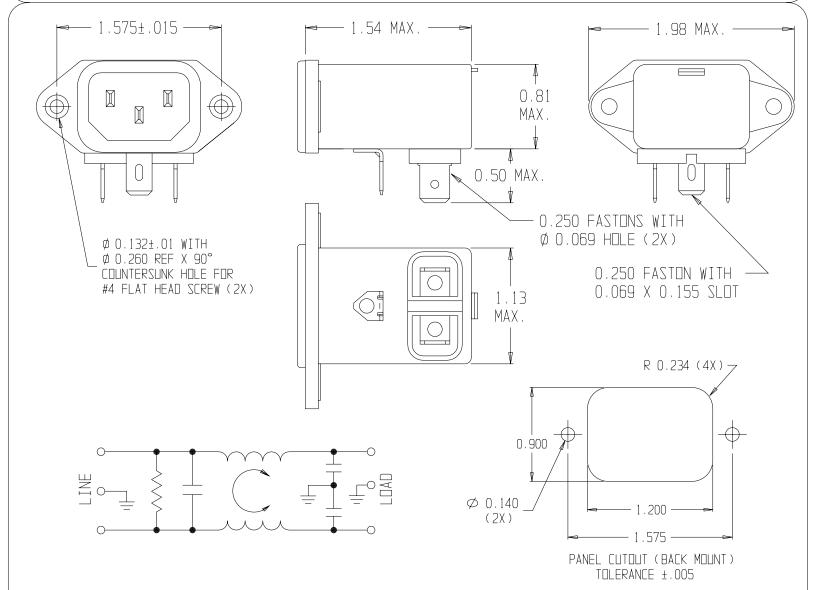

50A-50A(MINIMUM) INSERTION LOSS										
FREQUENCY MHz	. 05	. 10	. 15	. 50	1	1.5	5	10	30	
CDMMDN dB	10	15	19	30	36	_	48	50	47	
DIFF. dB				2	4	6	35	45	40	

PROJECTION UNLESS OTHERWISE SPECIFIED. TOLERANCE TO BE ±.025

THIRD ANGLE

MATERIAL & FINISH: AS SUPPLIED

This document is proprietary to CORCOM INC and is not to be reproduced nor used for manufacturing purposes except on CORCOM'S prior written consent.



POWER LINE FILTER

-	CAD FILE: C:	\CK\CD\3EEA200)	
	SCALE: NITS	DATE:	CATALOG NO.	REV.
	1/1/2	9/18/96	90019	امما
	DRW. BY:	DRIG:	1 3EEA2	00
	J⊨	KAW		